

MICRO-HYDRO INSTALLATION SIZING CALCULATIONS

Jacques Chaurette eng.

January 17, 2008

Calculations for micro-hydro turbine jet impact velocity are based on the same sort of calculations done for pump systems, except there is no pump. The energy is provided by the difference in elevation between the inlet and outlet of the system (see Figure 1). The inlet (point 1) is defined as the surface elevation of the water source and the outlet is at the nozzle outlet (point 2).

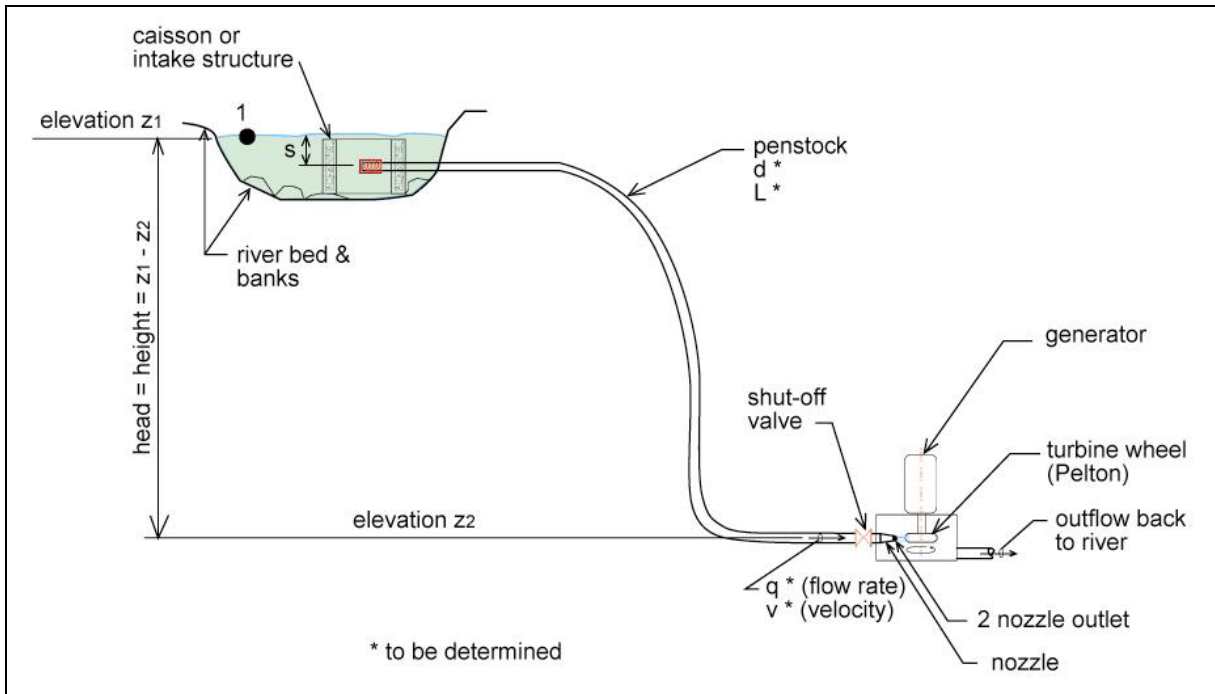


Figure 1. Typical micro-hydro installation.

The general equation for fluid flow between two points is:

$$z_1 + H_1 + \frac{v_1^2}{2g} + = z_2 + H_2 + \frac{v_2^2}{2g} + H_F \quad (1)$$

where z_1 and z_2 are respectively the elevation at points 1 and 2. We also have velocity and pressure head at points 1 and 2.

Calculating velocity from flow rate

The flow rate in a pipe depends on velocity and surface area:

$$q = v \times A = v \times \frac{\pi}{4} \times d^2$$

since the surface area for a pipe is $\pi d^2/4$. Using consistent units in the Imperial system we obtain:

$$q \left(\frac{USgal}{min} \right) = v \left(\frac{ft}{s} \right) \times \left(\frac{\pi}{4} \right) \times d^2 (in^2) \times \left(\frac{ft^2}{144 in^2} \right) \times \left(\frac{60s}{min} \right) \times \left(\frac{7.48 gal}{ft^3} \right)$$

and after simplification:

$$q(gpm) = 2.448 \times v \left(\frac{ft}{s} \right) \times d^2 (in^2) \quad (2)$$

or

$$v \left(\frac{ft}{s} \right) = \frac{0.4085 \times q(gpm)}{d^2 (in^2)} \quad (3) \text{ Imperial units}$$

or

$$v \left(\frac{m}{s} \right) = \frac{21.22 \times q(L/min)}{d^2 (mm^2)} \quad (3-1) \text{ metric units}$$

Calculating nozzle velocity v_2

The velocity v_1 is the velocity of fluid particles at the water source surface (see Figure 1), this velocity will be quite small and negligible, $v_1 = 0$. The velocity v_2 is the velocity of the water jet at the nozzle; this is the quantity we are looking for. The pressure head H_1 corresponds to any external pressure that might be imposed at point 1, in this case it is zero, $H_1 = 0$. The pressure head H_2 is the pressure at the outlet of the nozzle, since the water jet comes out in the free atmosphere $H_2 = 0$. H_F is the friction loss between points 1 and 2, it is comprised of the pipe friction loss, filter intake loss, fittings and manual valve losses. g is the acceleration due to gravity, $g = 32.17 \text{ ft/s}^2$. If we replace these values into equation (1) we obtain:

$$\frac{v_2^2}{2g} = z_1 - z_2 - H_F \quad (4)$$

v_2 becomes:

$$v_2 (ft/s) = \sqrt{2 \times 32.17 \times (z_1(ft) - z_2(ft) - H_F(ft))} \quad (5) \text{ Imperial units}$$

or

$$v_2(m/s) = \sqrt{2 \times 9.81 \times (z_1(m) - z_2(m) - H_F(m))} \quad (5-1) \text{ metric units}$$

Solving equation (5) is an iterative process, first we give a trial value to the flow rate q and then calculate H_F based on the applet found at this link:

<http://www.lightmypump.com/applets.htm#applets13>

and from this result we then calculate v_2 again based on equation (5). If the values are different modify the value of v_2 and try again until the trial value is the same as the calculated value.

Or you can use the formulas that are explained on this page to do your own calculations:

<http://www.lightmypump.com/help14.html>

or use this spreadsheet that has these formulas already programmed:

<http://www.lightmypump.com/reducer.xls>

Calculating available power

The design of the Pelton turbine is such that it is at its most efficient when its peripheral speed is half the speed of the incoming water jet. See this web page for a good explanation of how power is derived for a Pelton turbine:

<http://mysite.du.edu/~jcalvert/tech/fluids/turbine.htm>

The power in the water jet is equal to $\gamma h q$ where γ gamma is the specific weight of water, h is the available head and q the flow rate. If we know the velocity, the power can be expressed as $1/2 \rho v^2 q$ where ρ rho is the water density and v the water jet nozzle velocity. Either one of these expressions gives the theoretical power available from the water jet.

The Pelton turbine is designed to produce maximum power when the peripheral speed is $1/2$ of the water jet speed. The power transmitted to the turbine wheel is $0.5 \gamma h q$. The 50% is theoretical and is based on the fact that the water jet is reversed due to the wheel cup design 180 degrees back towards its source. The reversed water jet is not exactly in line so that the wheel itself has a real world efficiency of 90% or better. Therefore that power at the turbine wheel is:

$$0.9 \times 0.5 \times \gamma \times h \times q$$

or

$$0.9 \times 0.5 \times \rho \times g \times h \times q$$

using imperial units

$$P(kW) = 0.9 \times 0.5 \times 62.34 \left(\frac{\text{lb}_f}{\text{ft}^3} \right) \times q \left(\frac{\text{gals}}{\text{min}} \right) \times \left(\frac{\text{ft}^3}{7.48 \text{ gals}} \right) \times \left(\frac{\text{min}}{60 \text{ s}} \right) \times h(\text{ft}) \times \left(\frac{\text{hp}}{550 \left(\frac{\text{lb}_f \cdot \text{ft}}{\text{s}} \right)} \right) \times \left(\frac{\text{kW}}{1.34 \text{ hp}} \right)$$

or in metric units

$$P(kW) = 0.9 \times 0.5 \times 1000 \left(\frac{\text{kg}}{\text{m}^3} \right) \times 9.81 \left(\frac{\text{m}}{\text{s}^2} \right) \times q \left(\frac{\text{L}}{\text{min}} \right) \times \left(\frac{\text{m}^3}{1000 \text{ L}} \right) \times \left(\frac{\text{min}}{60 \text{ s}} \right) \times h(\text{m}) \times \left(\frac{\text{watt}}{\left(\frac{\text{kg} \cdot \text{m}^2}{\text{s}^3} \right)} \right) \times \left(\frac{\text{kW}}{1000 \text{ watt}} \right)$$

which simplifies to:

$$P(kW) = 0.9 \times 0.5 \times 1.88 \times 10^{-4} \times h(\text{ft}) \times q(\text{USgpm}) \quad (6)$$

or in metric units

$$P(kW) = 0.9 \times 0.5 \times 1.635 \times 10^{-4} \times h(\text{m}) \times q(\text{L/min}) \quad (6-1)$$

if we use the formula using nozzle velocity

$$P = 0.9 \times 0.5 \times \frac{1}{2} \times \rho \times q \times \frac{1}{g_c} \times v_2^2 \quad (7)$$

where ρ is the density and q the volumetric flow rate. To make all the units consistent in the Imperial system the power P in equation (7) must be divided by the constant g_c , using the proper units with their conversion factors and the water density of 62.34 lbm/ft^3 , we obtain:

$$P(kW) = 0.9 \times 0.5 \times \frac{1}{2} \times 62.34 \left(\frac{\text{lbm}}{\text{ft}^3} \right) \times \left(\frac{1}{32.17 \left(\frac{\text{lbm} \cdot \text{ft}}{\text{lb}_f \cdot \text{s}^2} \right)} \right) \times q \left(\frac{\text{gals}}{\text{min}} \right) \times \left(\frac{\text{ft}^3}{7.48 \text{ gals}} \right) \times \left(\frac{\text{min}}{60 \text{ s}} \right) \times v_2^2 \left(\frac{\text{ft}^2}{\text{s}^2} \right) \times \left(\frac{\text{hp}}{550 \left(\frac{\text{lb}_f \cdot \text{ft}}{\text{s}} \right)} \right) \times \left(\frac{\text{kW}}{1.34 \text{ hp}} \right)$$

which simplifies to:

$$P(kW) = 0.9 \times 0.5 \times 2.929 \times 10^{-6} \times q(USgpm) \times v^2(ft^2 / s^2) \quad (8)$$

or in metric units

$$P(kW) = 0.9 \times 0.5 \times \frac{1}{2} \times 1000 \left(\frac{kg}{m^3} \right) \times q \left(\frac{L}{min} \right) \times \left(\frac{m^3}{1000 L} \right) \times \left(\frac{min}{60s} \right) \times v^2 \left(\frac{m}{s} \right)^2 \times \left(\frac{watt}{\left(\frac{kg \cdot m^2}{s^3} \right)} \right) \times \left(\frac{kW}{1000 watt} \right)$$

which simplifies to:

$$P(kW) = 0.9 \times 0.5 \times 8.333 \times 10^{-6} \times q(L / min) \times v^2(m^2 / s^2) \quad (8-1)$$

Calculating turbine speed

The turbine peripheral velocity will be half the water jet velocity.

$$v_{turb} = \frac{1}{2} \times v_{jet} \quad (9)$$

The equation for rotational vs. peripheral turbine velocity is:

$$v_{turb} \left(\frac{ft}{s} \right) = \omega_{turb} \left(\frac{rad}{s} \right) \times \frac{d_{turb}(ft)}{2} \quad (10)$$

where ω is the rotational velocity in radians/second and d the diameter of the turbine wheel. We would like to use the units of rpm for ω and inch for d.

Therefore equation (10) becomes:

$$v_{turb} \left(\frac{ft}{s} \right) = \omega_{turb} \left(\frac{rev}{min} \right) \times \left(\frac{2\pi(rad)}{rev.} \right) \times \left(\frac{min}{60s} \right) \times \left(\frac{ft}{12in} \right) \times \frac{d_{turb}(in)}{2} \quad (11)$$

or in metric units

$$v_{turb} \left(\frac{m}{s} \right) = \omega_{turb} \left(\frac{rev}{min} \right) \times \left(\frac{2\pi(rad)}{rev.} \right) \times \left(\frac{min}{60s} \right) \times \frac{d_{turb}(mm)}{2} \times \left(\frac{m}{1000mm} \right) \quad (11-1)$$

and after simplification equation (11) becomes:

$$v_{turb}(ft / s) = 4.363 \times 10^{-3} \times \omega_{turb}(rpm) \times d_{turb}(in) \quad (12)$$

or in metric units

$$v_{turb} (m / s) = 5.235 \times 10^{-5} \times \omega_{turb} (rpm) \times d_{turb} (mm) \quad (12-1)$$

by replacing the value of v_{turb} in equation (9) into equation (11) we obtain:

$$0.5 \times v_{jet} (ft / s) = 4.363 \times 10^{-3} \times \omega_{turb} (rpm) \times d_{turb} (in) \quad (13)$$

or in metric units

$$0.5 \times v_{jet} (m / s) = 5.235 \times 10^{-5} \times \omega_{turb} (rpm) \times d_{turb} (mm) \quad (13-1)$$

therefore the rotational velocity of the turbine is:

$$\omega_{turb} (rpm) = 0.5 \times 229.2 \times \frac{v_{jet} (ft / s)}{d_{turb} (in)} \quad (14)$$

or in metric units

$$\omega_{turb} (rpm) = 0.5 \times 1.91 \times 10^4 \times \frac{v_{jet} (m / s)}{d_{turb} (mm)} \quad (14-1)$$